


PLAN

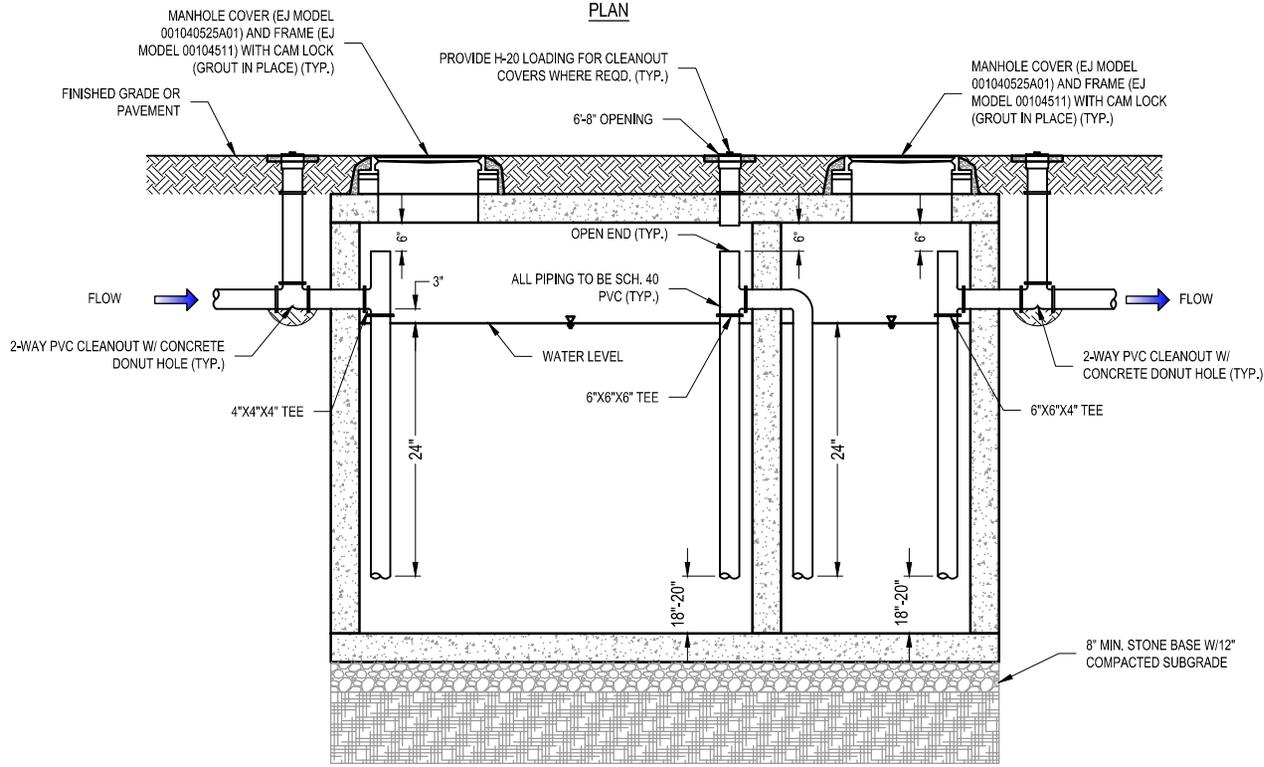

PROFILE

NOTES:

1. USE NON-SHRINK GROUT AT ALL PENETRATIONS.
2. PROVIDE BUTYL RUBBER SEAL BETWEEN ALL SECTIONS AND TOP
3. ALL TEES THROUGHOUT TANK MUST BE DWV PVC 40

TRAP DIMENSIONS		
LIQUID CAPACITY (GALLONS)	WIDTH (W)	LENGTH (L)
1,000	5'-1"	8'-2"
1,200	5'-9"	8'-6"
1,500	5'-7"	10'-8"
2,000	4'-11"	15'-11"

OCONEE JOINT REGIONAL SEWER AUTHORITY
FATS, OILS & GREASE INTERCEPTOR



DATE: 07/2019	DRAWING NO.: CD 521
REVISED: 08/2021	SCALE: NTS